


REVISION NO. 3

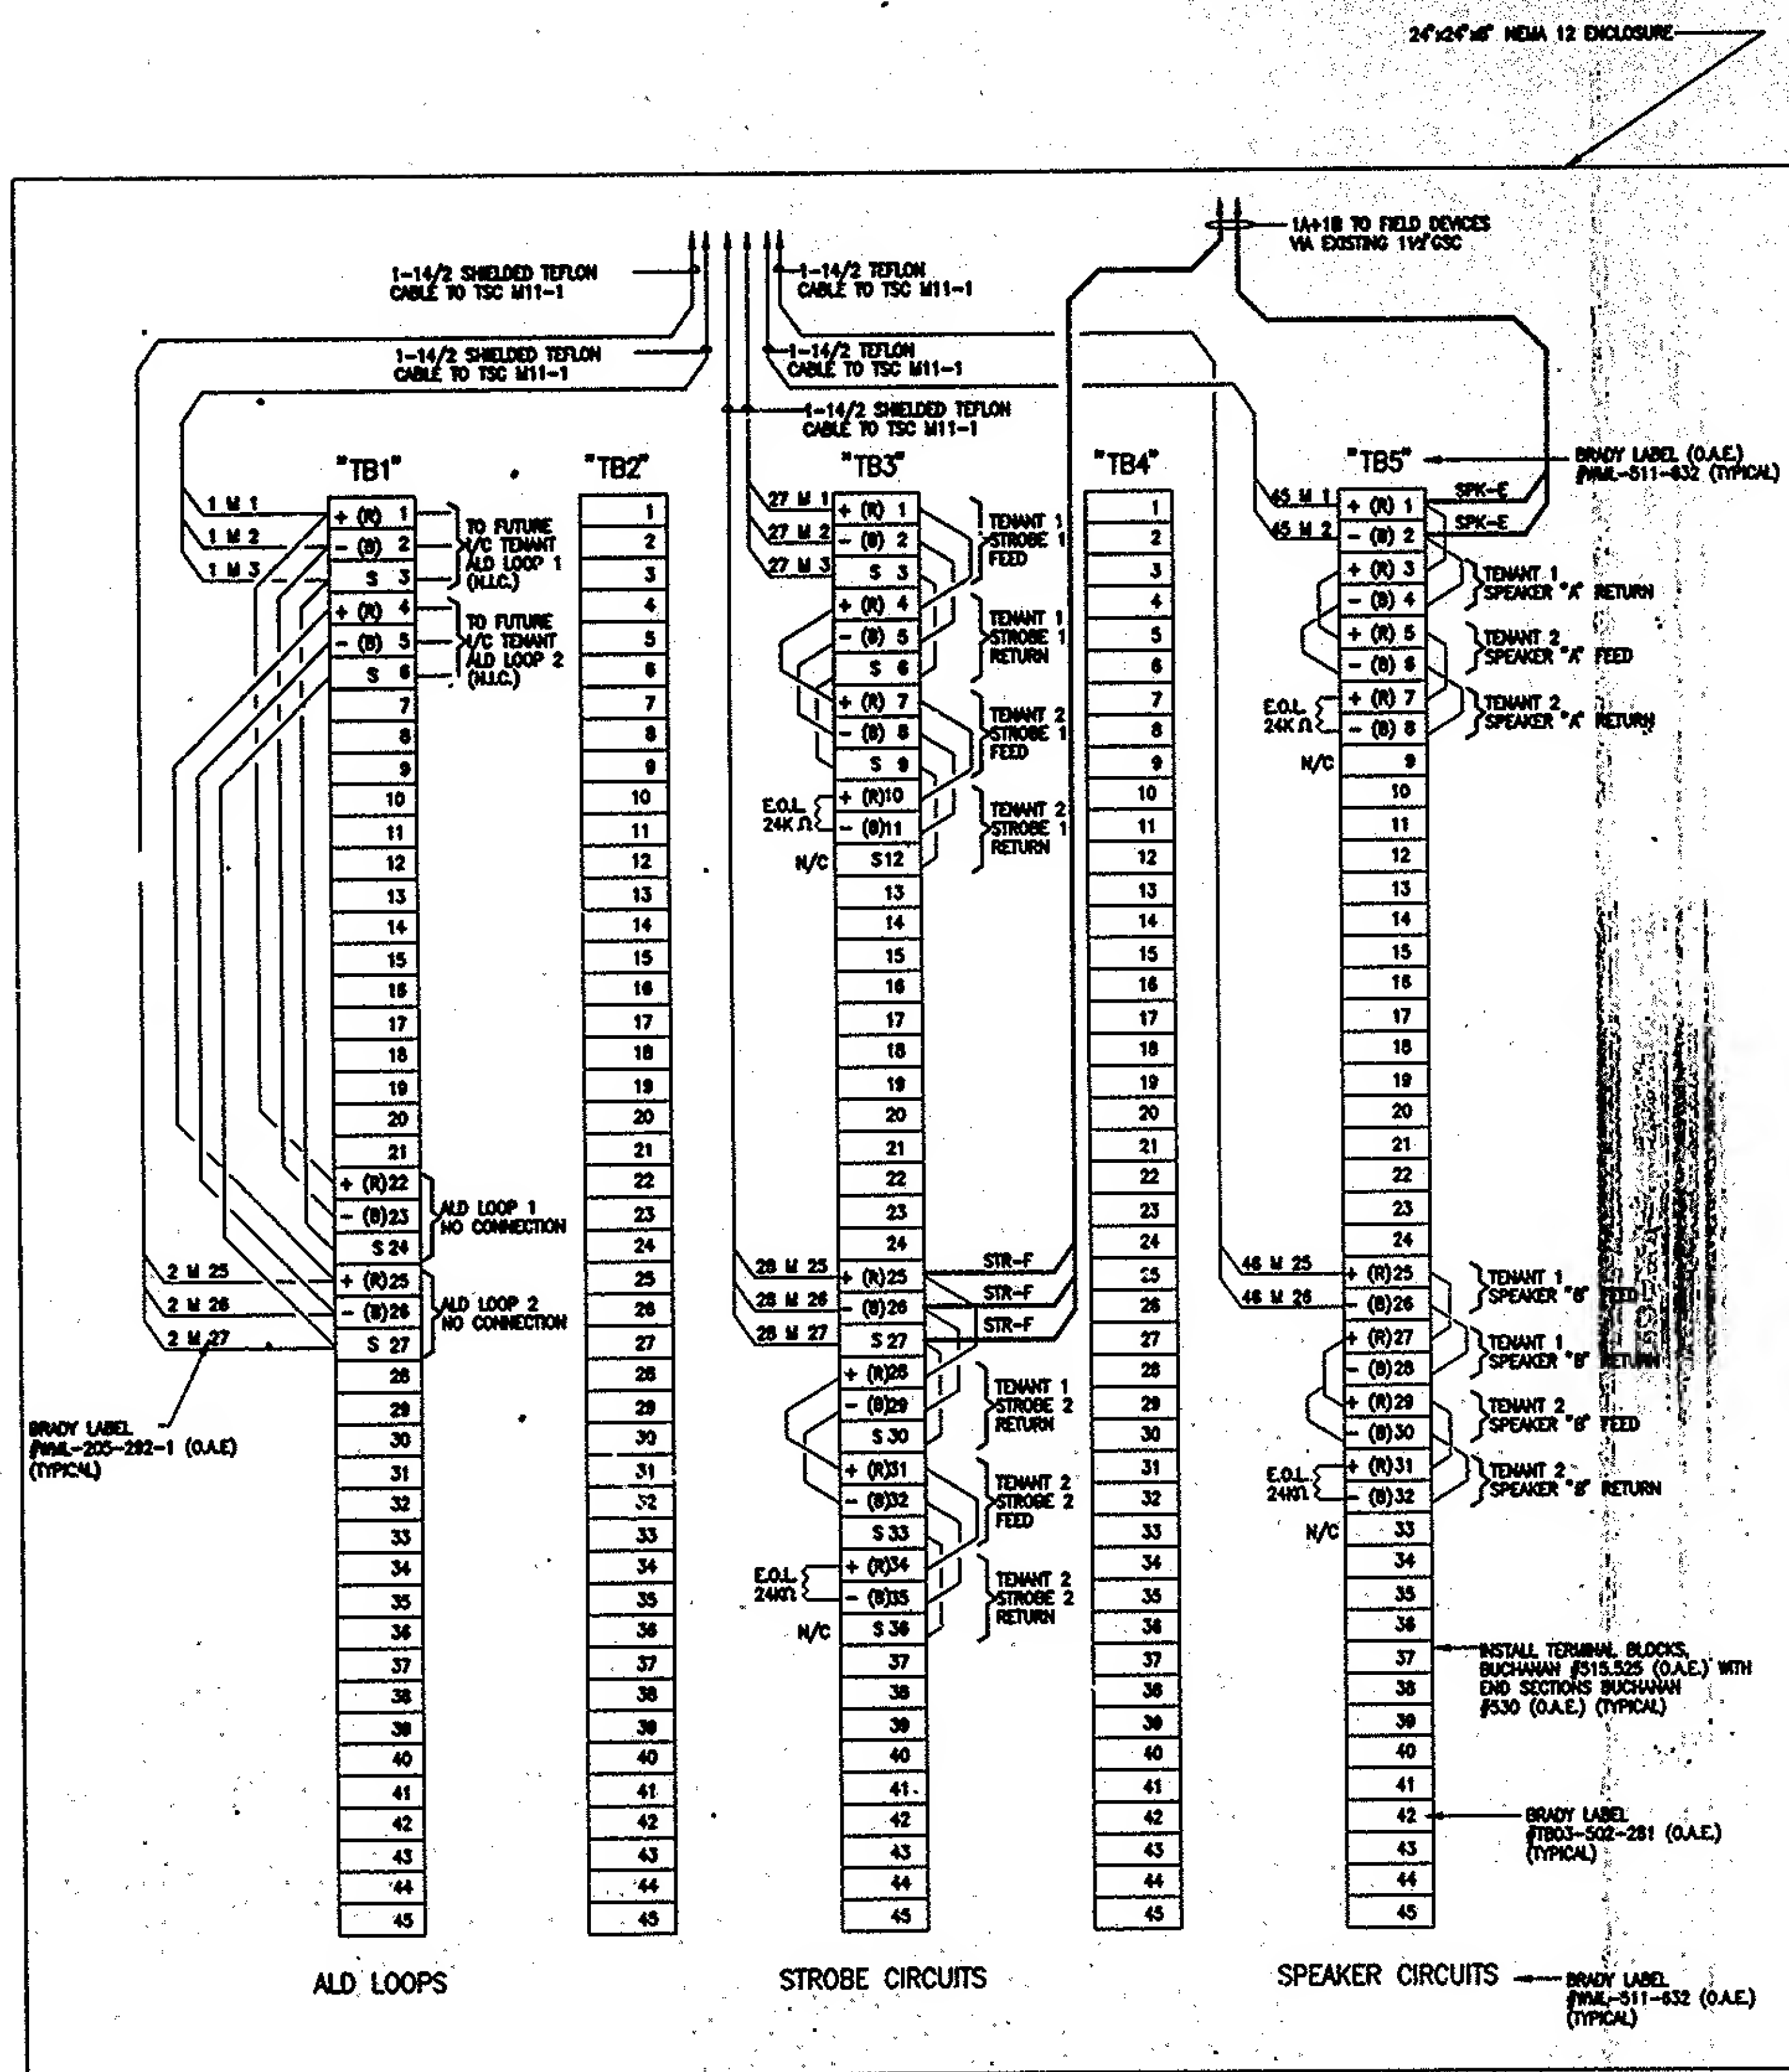

TSC-F1A-NE3

NOTES:

1. FOR LEGEND, ABBREVIATIONS
2. ALL SHIELDS MUST BE ISOLATED. TUBING SHALL BE USED ON ALL (ON THIS DWG).
3. ALL WIRING SHALL BE FREE OF STRAY VOLTAGES.
4. CONTRACTOR SHALL SHAPE THE CONNECTION SHALL BE MADE AND UNDER THE DIRECT SUPERVISION OF THE PROJECT MANAGER.
5. FOR TSC-F1A-NE3 ENCLOSURE WIRING PLAN.

LEGEND:

- 400/25
- 814 AWG  
14 M  
25  
1  
A  
B
- TB2 -  
(+)  
(-)  
(R)  
(S)  
2
- + (R) 2

